



SECTION OPTION 1

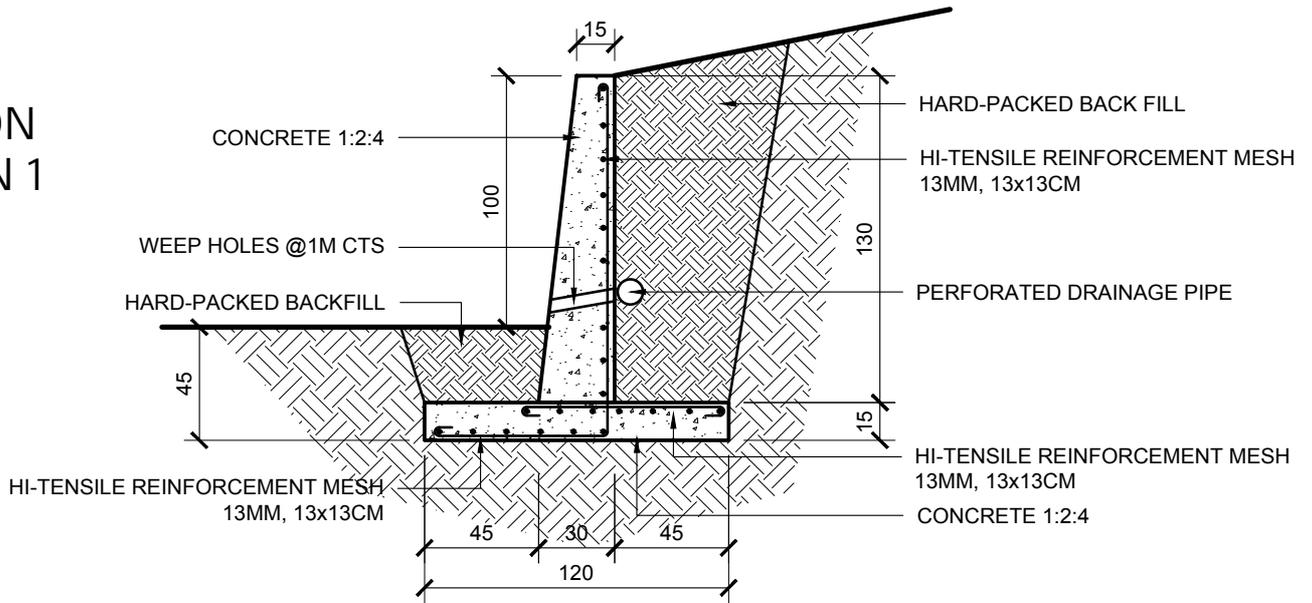

SECTION OPTION 2

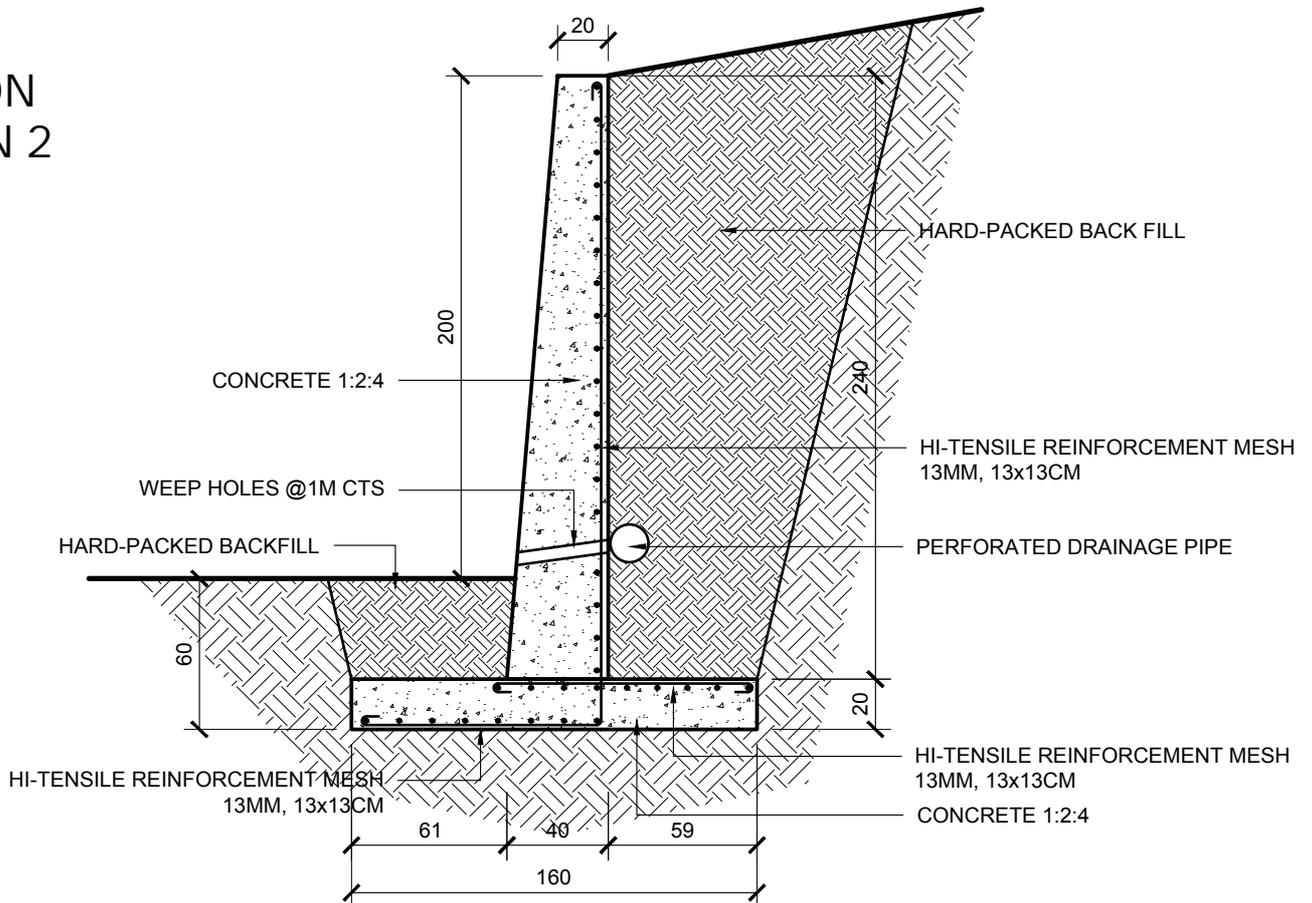

NOTES

1. Refer to Specification for material descriptions.
2. Structural design to be verified by local engineer for compliance with local conditions and norms
3. Ensure the correct water content of mixed concrete - slump test should yield $< \frac{1}{4}$ height reduction.
4. Slabs to be cast in a single pour. All concrete works to be vibrated or well rodded.
5. Ensure all poured concrete is kept damp and out of direct sunlight for at least 7 days while curing.

DWG NO. **F1-1**
 TITLE Retaining Wall - Reinforced concrete
 PROJECT Community Infrastructure Catalogue

DRAWN BY AU
 CHECKED BY RN
 SCALE 1:30
 UNITS CM
 SHEET 1 of 1
 DATE 31.08.2023