


LONG SECTION BB

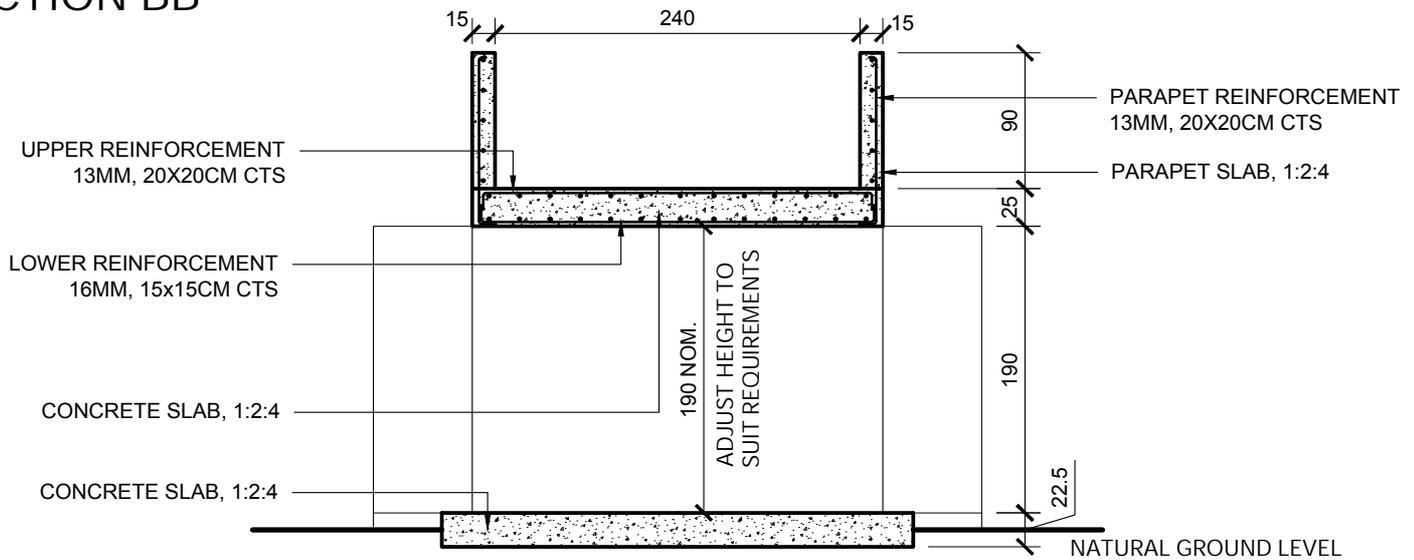

NOTES

1. Refer to Specification for material descriptions.
2. Structural design to be verified by local engineer for compliance with local conditions and norms
3. Ensure the correct water content of mixed concrete - slump test should yield $< 1/4$ height reduction.
4. Slabs to be cast in a single pour. All concrete works to be vibrated or well rodded.
5. Ensure all poured concrete is kept damp and out of direct sunlight for at least 7 days while curing.
6. Span and height dimensions nominal - adjust to suit site conditions and requirements.

DWG NO. **E1-2**

TITLE
Culvert - Brick Masonry
Long Section

PROJECT
Community Infrastructure Catalogue

DRAWN BY
AU

CHECKED BY
RN

SCALE
1:50

UNITS
CM

SHEET
2 of 2

DATE
31.08.2023



UNHCR
The UN Refugee Agency

Technical Support Section
Community Infrastructure Catalogue